

*This Technical Committee Report has been prepared by NACE International Task Group (TG) 023, "High-Voltage Direct Current (DC) Transmission: Effects on Buried or Submerged Metallic Structures."*

## High-Voltage Direct Current Interference

© May 2014, NACE International

*This NACE International (NACE) technical committee report represents a consensus of those individual members who have reviewed this document, its scope, and provisions. Its acceptance does not in any respect preclude anyone from manufacturing, marketing, purchasing, or using products, processes, or procedures not included in this report. Nothing contained in this NACE report is to be construed as granting any right, by implication or otherwise, to manufacture, sell, or use in connection with any method, apparatus, or product covered by letters patent, or as indemnifying or protecting anyone against liability for infringement of letters patent. This report should in no way be interpreted as a restriction on the use of better procedures or materials not discussed herein. Neither is this report intended to apply in all cases relating to the subject. Unpredictable circumstances may negate the usefulness of this report in specific instances. NACE assumes no responsibility for the interpretation or use of this report by other parties. Users of this NACE report are responsible for reviewing appropriate health, safety, environmental, and regulatory documents and for determining their applicability in relation to this report prior to its use. This NACE report may not necessarily address all potential health and safety problems or environmental hazards associated with the use of materials, equipment, and/or operations detailed or referred to within this report.*

*Users of this NACE report are also responsible for establishing appropriate health, safety, and environmental protection practices, in consultation with appropriate regulatory authorities if necessary, to achieve compliance with any existing applicable regulatory requirements prior to the use of this report.*

*CAUTIONARY NOTICE: The user is cautioned to obtain the latest edition of this report. NACE reports are subject to periodic review, and may be revised or withdrawn at any time without prior notice. NACE reports are automatically withdrawn if more than 10 years old. Purchasers of NACE reports may receive current information on all NACE International publications by contacting the NACE FirstService Department, 15835 Park Ten Place, Houston, Texas 77084-5145 (telephone +1 281-228-6200).*

### Foreword

The purpose of this technical committee report is to present information and review data on the operation of high-voltage direct current (HVDC) transmission systems and their effect on underground/underwater or surface metallic structures, such as pipelines, telephone, electric power, and cable television signal transmission (CATV) cables, railways, reinforced concrete structures, etc. It is intended for individuals associated with the pipeline, water, cable, railway, and electrical transmission and distribution industries. Stray direct current (DC) associated with HVDC transmission systems can result from normal operation of monopolar transmission systems or unbalanced currents in bipolar transmission systems. Bipolar transmission systems can also generate significant levels of stray DC when operating in monopolar operation using the earth as a return circuit as a result of equipment faults or during planned maintenance of the system or converters.

This technical committee report was prepared by NACE Task Group (TG) 023, "High-Voltage Direct Current (DC) Transmission: Effects of Buried or Submerged Metallic Structures." TG 023 is administered by Specific Technology Group (STG) 05, "Cathodic/Anodic Protection," and is sponsored by STG 03, "Coatings and Linings, Protective—Immersion and Buried Service," and STG 35, "Pipelines, Tanks, and Well Casings." This report is issued under the auspices of STG 05, "Cathodic/Anodic Protection."

---

\*Chair Peter Nicholson, Markdale, ON

NACE technical committee reports are intended to convey technical information or state-of-the-art knowledge regarding corrosion. In many cases, they discuss specific applications of corrosion mitigation technology, whether considered successful or not. Statements used to convey this information are factual and are provided to the reader as input and guidance for consideration when applying this technology in the future. However, these statements are not intended to be recommendations for general application of this technology, and must not be construed as such.


**Table of Contents**

Introduction..... 2  
Definitions..... 4  
Stray Current Interference..... 4  
Underground/Underwater Pipelines ..... 4  
Telecommunication Cables..... 8  
Buried and Aerial Structures ..... 8  
Electric Power Cables and Facilities ..... 9  
Mitigation ..... 9  
Procedures..... 9  
Equipment ..... 9  
Long-Term Operation of HVDC Mitigation Systems ..... 10  
Monitoring..... 10  
New HVDC Transmission Systems..... 10  
Commission and Design of HVDC Systems ..... 11  
References..... 12  
Bibliography..... 12  
Appendix A: General Considerations for HVDC Systems ..... 13  
Appendix B: Typical Test Procedures for HVDC Systems ..... 13  
**FIGURES**  
Figure 1: Monopolar Earth-Return HVDC Transmission..... 3  
Figure 2: Bipolar HVDC Transmission ..... 3  
Figure 3: Graph Depicting HVDC Test Fault Current Magnitude and Pattern ..... 5  
Figure 4: Effect of HVDC Faults on a Pipeline ..... 6  
Figure 5: Pipe-to-Soil Potential on a Pipeline as a Result of Fault Current..... 6  
Figure 6: Current Flow on a Pipeline Affected by the HVDC Tests Fault Current..... 7  
Figure 7: HVDC Test Fault Current on the Pipe-to-Soil Potential of a Pipeline..... 7  
**TABLES**  
Table 1: Typical Log of HVDC Faults ..... 8

**Introduction**

HVDC transmission is used to carry electrical energy over long distances or to interface two alternating current (AC) power systems that might not be synchronized. HVDC transmission can be performed using monopolar systems, which are typically earth-return systems, or bipolar wire-return systems.


In monopolar systems, power is transmitted through a metallic conductor in one direction; see Figure 1. (IG refers to current flow in the Earth). Monopolar earth return systems use the earth as a conductor, and they typically use the sea as the earth return because of its low resistance and its ability to conduct large currents for a sustained period of time. Continuous operation of monopolar HVDC transmission systems is prohibited in some countries.

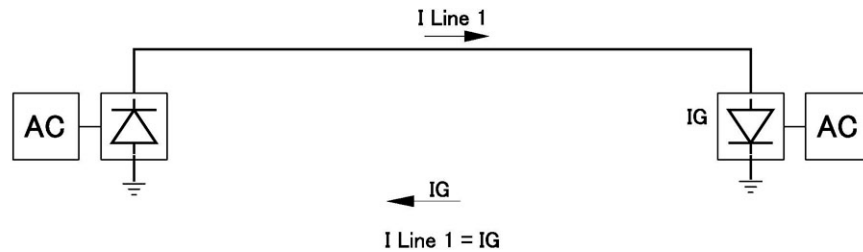

**Figure 1: Monopolar Earth-Return HVDC Transmission**

Back-to-back HVDC systems are generally used to solve synchronization problems or where different operating frequencies exist. These stations generally use a metallic return conductor rather than earth return. Monopolar *metallic* return systems do not use the earth as a conductor or earth return circuit.

Bipolar HVDC systems generally transmit power over a two-wire system where one wire is positive and the other wire is negative to ground (see Figure 2). Current through the earth is the unbalanced current between the two wires. In the case of a fault or equipment failure, bipolar systems generally revert to monopolar operation.

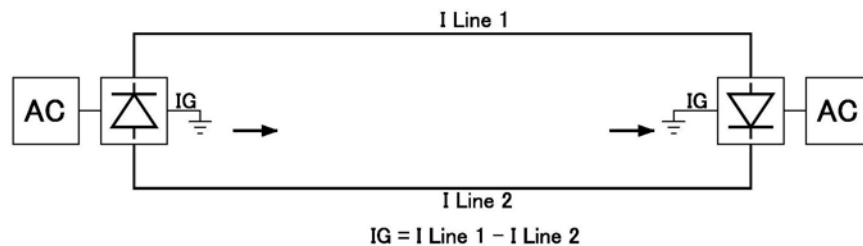

**Figure 2: Bipolar HVDC Transmission**

Both the operation of bipolar HVDC transmission systems that use the earth as a conductor of transmission currents and monopolar systems that use earth return currents can have serious repercussions on underground metallic structures. Whenever stray DC interference current discharges directly into the ground, corrosion occurs.

The following is a list of underground or underwater metallic structures that may be affected by HVDC stray currents. This list is not exhaustive.

- Oil pipelines,
- Gas pipelines,
- Slurry pipelines,
- Chemical products pipelines,
- Water transmission pipelines,
- Water distribution pipelines,
- Telephone cables,
- Pipe-type cables,
- CATV cables,
- Railways,
- Electrical transmission and distribution systems, and
- Any other underground/underwater metallic plant.